


Exhibit "B"

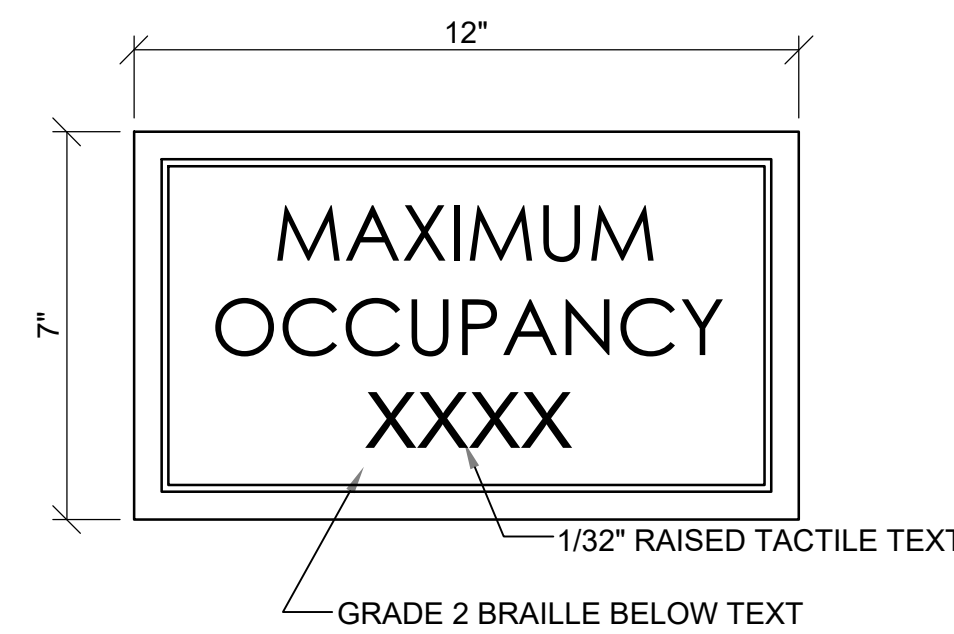

12" x 7" ACRYLIC PANEL OCCUPANCY SIGN. WHITE GRAPHICS ON BLUE BACKGROUND INSTALL AT 60" A.F.F. MAXIMUM ADJACENT TO ENTRANCE DOORS.

2 OCCUPANCY POSTING
3" = 1'-0"

OCCUPANCY COUNT				
Room Name	Area Occupancy Key	Area	Load Factor	Occupancy Count
CHECK-IN/WAIVERS	Exercise Area	2,327 SF	50	47
OFFICES	Business	168 SF	150	1
BREAKROOM	Business	274 SF	150	2
KITCHEN	Kitchen - Commercial	1,383 SF	200	7
PLAY AREAS	Exercise Rooms	5,469 SF	50	110
SEATING	Assembly - Unconcentrated (Tables & chairs)	3,817 SF	15	258
SLIDES	Exercise Rooms	4,062 SF	50	81
CIRCULATION	Exercise Rooms	9,504 SF	50	190
STORAGE	Acc. Stor. Areas, Mech. Equipment rooms	418 SF	300	1
RESTROOMS	Acc. Stor. Areas, Mech. Equipment rooms	558 SF	0	0
EMPLOYEE ONLY	Accessory Storage Areas, Mechanical equipment rooms	7,450 SF	300	5
TOTAL OCCUPANCY		35,450 SF		722

SYMBOL LEGEND	
	ORIGINATION POINT
	PATH/DIRECTION OF EGRESS TRAVEL
	FIRE EXTINGUISHER LOCATION
	EMERGENCY EXIT SIGN (REFER TO ELECTRICAL DRAWINGS)
	EMERGENCY LIGHT (REFER TO ELECTRICAL DRAWINGS)
	NEW 1-HOUR RATED WALL/PARTITION
	36" MIN ACCESSIBLE ROUTE

GENERAL NOTES

1. TENANTS GC IS REQUIRED TO CHECK IN WITH LANDLORD'S ON SITE PROPERTY MANAGER PRIOR TO THE START OF TENANT CONSTRUCTION.
2. PLANS REVIEWED AND APPROVED BY LANDLORD'S TENANT COORDINATOR MUST BE PRESENT ON THE JOB SITE AND BE ACCOMPANIED BY PLANS APPROVED FOR FIRE PERMIT.

LIFE SAFETY GENERAL NOTES


1. 44" REQUIRED EGRESS CORRIDOR WIDTH FOR OCCUPANCIES OF 50 AND OVER. 42" REQUIRED EGRESS ASLE WIDTH FOR OCCUPANCIES 50 AND OVER. 36" REQUIRED EGRESS WIDTH FOR OCCUPANCIES UNDER 50. FBC SEC 1018.2
2. NO DEAD END CORRIDORS OVER 50'-0" IN LENGTH. IBC SEC 1020.5
3. MAXIMUM COMMON PATH OF EGRESS TRAVEL IS 30'-0". FBC SEC 1029.8
4. MAXIMUM EXIT ACCESS TRAVEL DISTANCE 250'-0" WITH SPRINKLERS. FBC TABLE 1017.2
5. DISTANCE BETWEEN TWO POINTS OF EGRESS MEASURED IN A STRAIGHT LINE BETWEEN THE TWO SHALL NOT BE LESS THAN 1/3 THE DIAGONAL OF THE SPACE BEING SERVED FOR EGRESS PATH. FBC SEC 1007.1.1.2
6. SPACE BETWEEN TWO DOORS IN A SERIES SHALL BE 48" MINIMUM PLUS WIDTH OF A DOOR SWINGING INTO THE SPACE. FBC SEC 1010.1.7
7. LANDINGS SHALL HAVE A LENGTH MEASURED IN THE DIRECTION OF TRAVEL NOT LESS THAN 44 INCHES.
8. DOORS, WHEN FULLY OPENED, SHALL NOT REDUCE THE REQUIRED MEANS OF EGRESS WIDTH BY MORE THAN 7 INCHES. DOORS IN ANY POSITION SHALL NOT REDUCE THE REQUIRED WIDTH BY MORE THAN ONE HALF. FBC SEC 1005.7.1.
9. PER FBC, ABC EXTINGUISHERS ARE REQUIRED WITHIN 75'-0" OF TRAVEL DISTANCE OF ALL AREAS.
10. NFPA INSPECTION TAGS SHALL BE ATTACHED TO ALL FIRE EXTINGUISHERS.

FIRE EXTINGUISHER NOTES

- A. G.C. TO PROVIDE MIN. OF 12 FIRE EXTINGUISHERS, G.C. TO VERIFY AND COORDINATE LOCATIONS AND QUANTITIES WITH LOCAL FIRE MARSHAL.
- B. PER 2023 FBC, TABLE 906.3(1), THE MINIMUM IS A 2A:10B:C EXTINGUISHER WITHIN 75' OF TRAVEL DISTANCE OF ALL AREAS.
- C. FIRE EXTINGUISHER TO BE PROVIDED WITHIN 30 FEET OF COMMERCIAL COOKING EQUIPMENT PER 2023 FBC, SECTION 906.1
- D. NFPA INSPECTION TAGS SHALL BE ATTACHED TO ALL FIRE EXTINGUISHERS.
- E. PROPERLY LABEL FIRE EXTINGUISHER LOCATIONS, CONSULT LOCAL JURISDICTION FOR REQUIREMENTS.

KEYED NOTES

1. KITCHEN (CLASS 'K') FIRE EXTINGUISHER. VERIFY FINAL LOCATION WITH FIRE MARSHAL.
2. 12 SURFACE MOUNTED FIRE EXTINGUISHERS, PER TABLE 906.3(1) OF THE 2023 FBC, LIGHT HAZARD OCCUPANCY FIRE EXTINGUISHER
3. POST MAXIMUM OCCUPANCY SIGN PER 2023 FBC. SEE 11/G003 FOR SIGN AND MOUNTING DETAILS. VERIFY EXACT LOCATION IN THE FIELD.

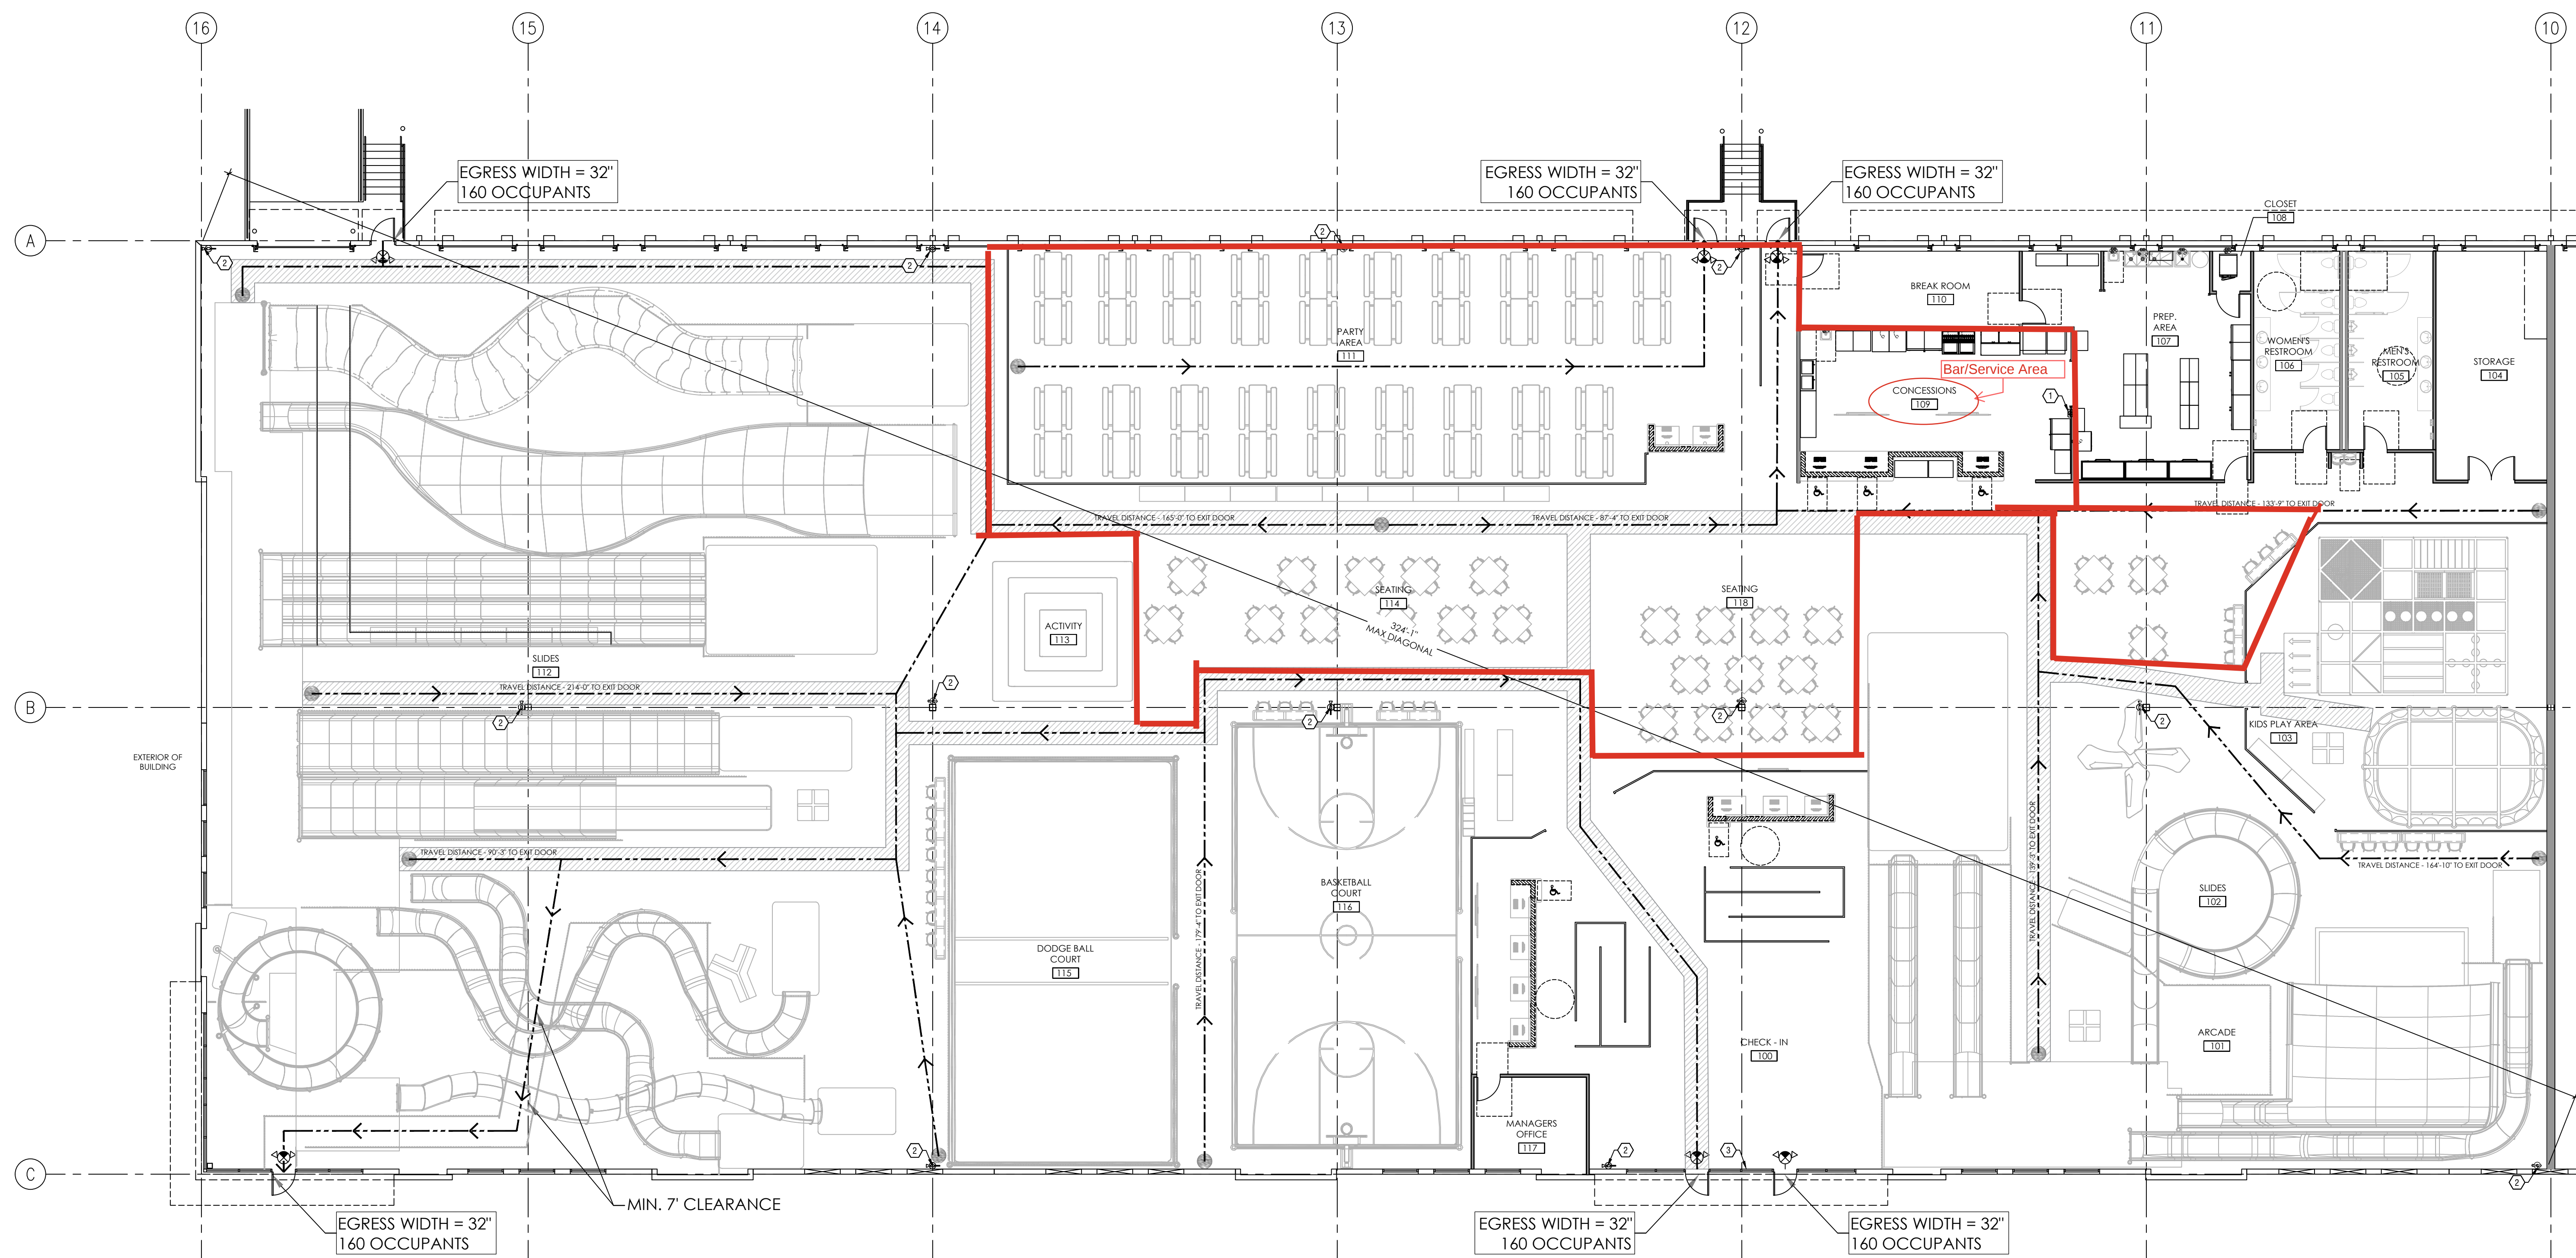

1 LIFE SAFETY PLAN
3/32" = 1'-0"

SHEET NUMBER
G0.1



**TYPE-SIX
DESIGN AND
DEVELOPMENT SERVICES**

920 S. MAIN ST., #150
GRAPEVINE, TX 76051

PROJECT MANAGER
steven.coburn@type-six.com
805-469-2060



SLICK CITY- FT. MYERS
16200 BEN HILL GRIFFIN PARKWAY
FT. MYERS, FL, 33913

T6_25002

ARCHITECT
D. HAYES HINKLE

ORIGINAL ISSUE DATE
03_07_2025

ISSUED FOR
PERMIT

REVISIONS

SHEET NAME
LIFE SAFETY PLAN

